SAFETY ORGANIZATIONS

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET:

UL RECOGNIZED: UL 1283 CSA CERTIFIED: CSA 22.2, # 8 VDE APPROVED: EN 133200

OPERATING SPECIFICATIONS

LINE CURRENT/YOLTAGE: 2 AMP/40°C, 120/250YAC

LINE FREQUENCY: 50-60Hz

MAXIMUM LEAKAGE CURRENT,

0.40mA@ 120V, 60Hz EACH LINE TO GROUND: 0.70mA@ 250V, 50Hz

OPERATING AMBIENT TEMP. RANGE: -10°C TO +40°C @ RATED CURRENT, Ic.

IN AN AMBIENT, T_0 , HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT, I_0 , IS AS FOLLOWS: $I_0 = I_0 - \sqrt{100 - I_0}$ 100 - T₀ $I_0 = I_r - /$ 60

RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE: -40°C TO +85°C HUMIDITY: 21 DAYS @ 40°C 95% RH.
CURRENT DYERLOAD TEST: 6 TIMES I FOR 8 ZECONOS

TEST SPECIFICATIONS:

INDUCTANCE: 0.539mH NOMINAL CAPACITANCE: (MEASURED @ 1KHz, 0.250VAC MAX., 25°C±1°C)

LINE TO GROUND: 0.0089µF ±20% LINE TO LINE: 0.012uF ±20% Ĩ.5M ∧ DISCHARGE RESISTOR

L/G ÅND L/L I.R. NO DISCHARGE RESISTOR:

CATALOG # 2VB3

ECO # APPRYD DATE


|30N□V06

RECOMMENDED RECEIVING INSPECTION HIPOT:

LINE TO GROUND: 1500YAC OR 2250YDC FOR 1 MINUTE LINE TO LINE: 1450YDC FOR 1 MINUTE

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

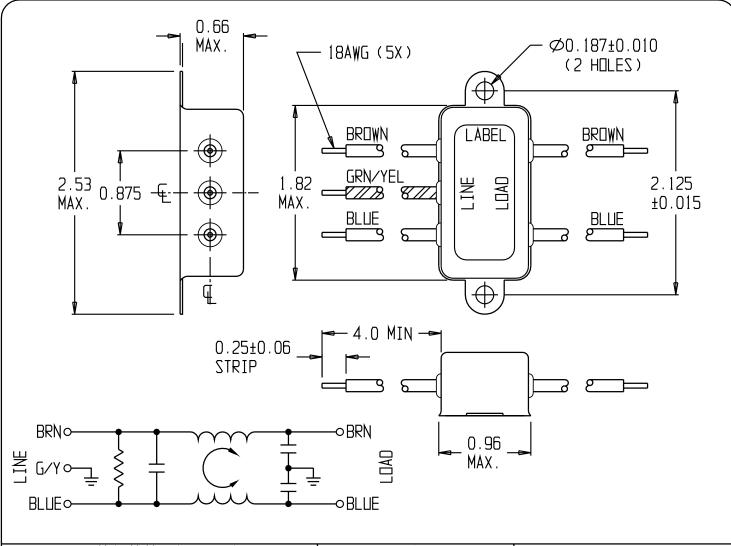

50A- 50A(MINIMUM) INSERTION LOSS										Ţ	
FREQUENCY MHz	0.15	0.5	1.0	2.0	5.0	10	20	30			F
C□MM□N	8	20	28	36	45	50	52	54			Th
DIFF. dB											no pr

THIRD ANGLE OPROJECTION UNLESS OTHERWISE SPECIFIED, TOLERANCE TO BE ± .025 MATERIAL & FINISH: AS SUPPLIED

his document is proprietory to CORCOM INC. and is not to be reproduced nor used for nonufocturing purposes except on CORCOM'S prior written consent.

TLICO Electronics COMO 620 S. BUTTERFIELD ROAD MUNDELEIN IL 60060

CUSTOMER DRAWING 2VB3

TYCO: 0-6609021-4							
	DATE: 12SEP89	CATALOG					
DRN. BY: JF	DRIG: CW	7					

G NO. REY. **2VB3** B